


Fieldbus-module assembly/exchange

Technical Information

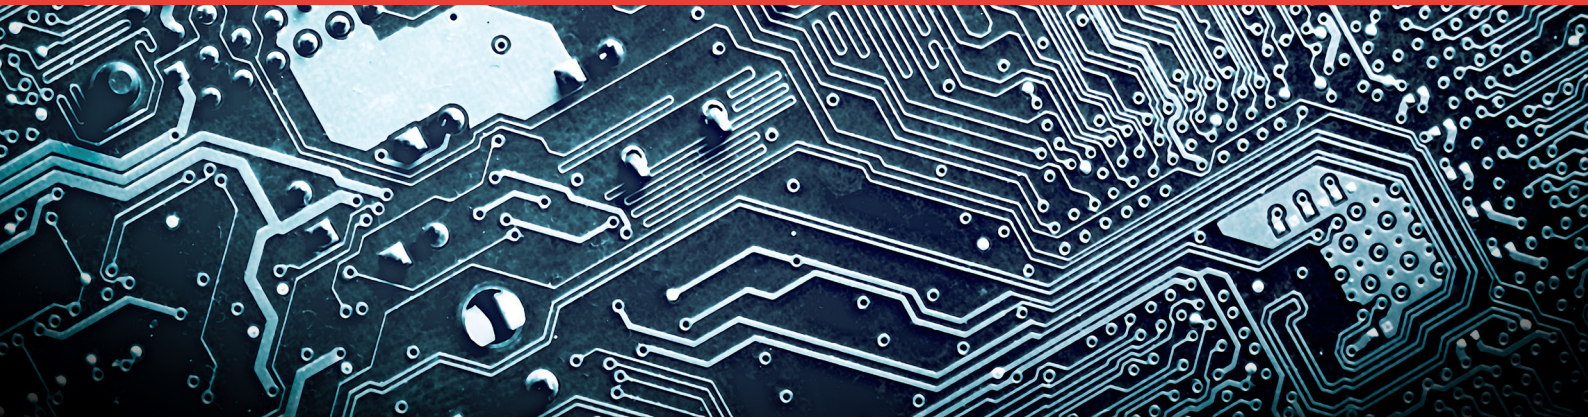


Caution!

When assembling or exchanging a fieldbus-module, care must be taken to avoid damage to the connector in the instrument.

Removal of fieldbus-module

To remove a module in the instrument, the two front screw shall be loosen and then the module can be extracted.

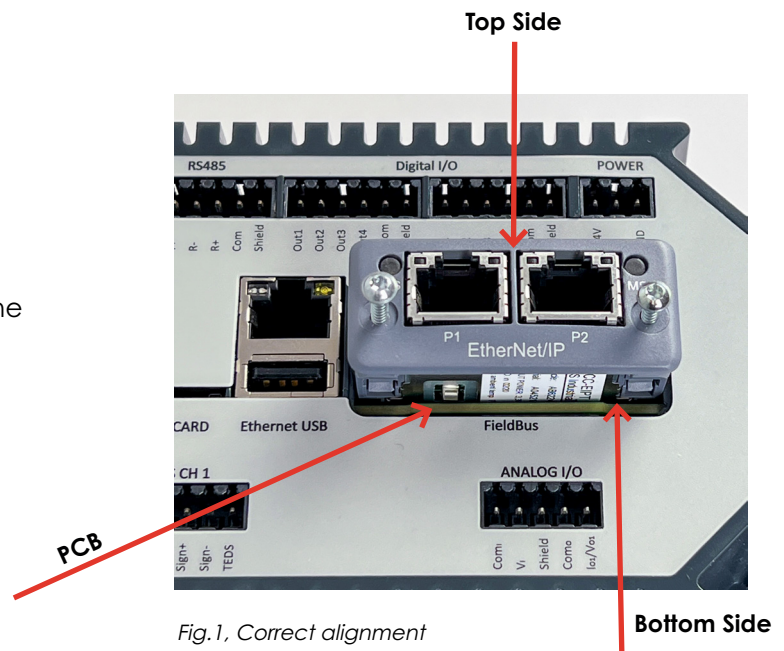

Assembly of fieldbus-module

There is a connector inside the instrument with multiple pins that connects to the fieldbus-module. It is important that the module is aligned correctly when it is inserted into its slot. Ensure that the bottom side of the module is sliding along with the PCB when it is inserted as shown in the pictures below.

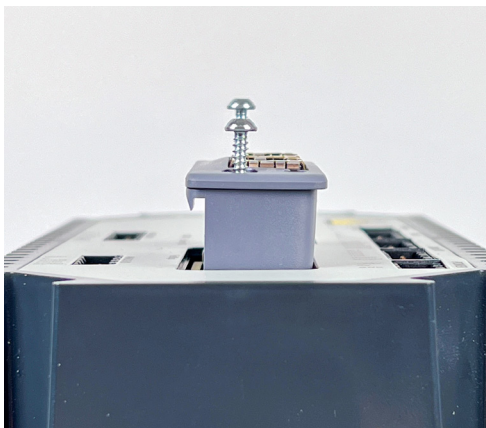


Fig.2, Correct alignment



Fig.3, Faulty alignment

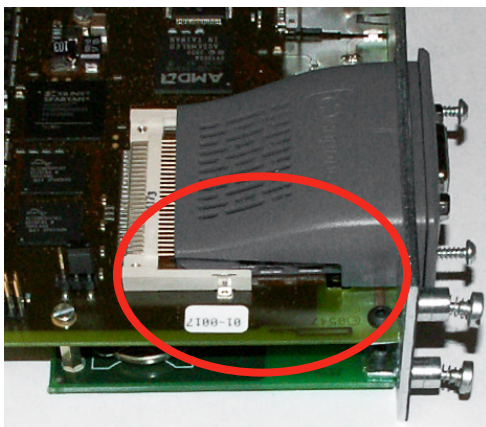


Fig.4, Correct alignment

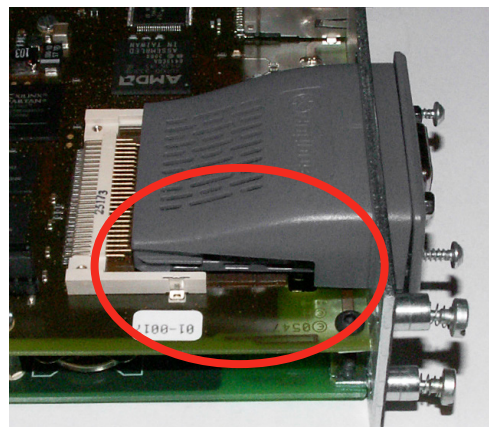


Fig.5, Faulty alignment